

Gate 5, 2 Normanby Road Clayton VIC 3168, Australia Telephone: 61 3 9545 2777 Web: http://www.csiro.au

Registered Testing Authority - CSIRO

16 October 2018

Our Ref. EN13 / 2410 03/0212

TEST REPORT No. 8163A

[This report replaced CSIRO report 8163]

Requested by:	Nolan.UDA Pty. Ltd. 3 Bradford Street Alexandria NSW 2015
on (date):	20 September 2018
Manufacturer:	Imported
Product Desc.:	Decord, PP carpet with Latex coating at back.
Sampling details:	
Where:	At customer premises
Date:	20 September 2018
By whom:	Customer (delivered by courier)
How (methods):	N/A

The results reported relate only to the sample(s) tested and the information received. No responsibility is taken for the accuracy of the sampling unless it is done under our own supervision. CSIRO cannot accept responsibility for deviations in the manufactured quality and performance of the product. While CSIRO takes care in preparing the reports it provides to clients, it does not warrant that the information in this particular report will be free of errors or omissions or that it will be suitable for the client's purposes. CSIRO will not be responsible for the results of any actions taken by the client or any other person on the basis of the information contained in the report or any opinions expressed in it. The reproduction of this test report is only authorised in the form of a complete photographic facsimile. Our written approval is necessary for any partial reproduction.

This test report consists of 4 pages

	SUMMARY OF SLIP RESISTANCE TESTS PERFORMED:	Result	Class
AS 4586:2013	Slip resistance classification of new pedestrian surface materials Appendix A: WET PENDULUM TEST METHOD (Slider 96):		
	Mean SRV:	59	P5

In order to interpret the classifications, please refer to Standards Australia Handbook 198, An Introductory Guide to the Slip Resistance of Pedestrian Surface Materials, which recommends minimum classifications for a wide variety of locations.

It is important to realise that test results obtained on unused factory-fresh samples may not be directly applicable in service, where proprietary surface coatings, contamination, wear and subsequent cleaning all influence the behaviour of the pedestrian surface.




Gate 5, 2 Normanby Road Clayton VIC 3168, Australia Telephone: 61 3 9545 2777 Web: http://www.csiro.au


REPORT NO:8163AISSUE DATE:16 October 2018MANUFACTURER:ImportedPRODUCT DESC:Decord, PP carpet with Latex coating at back.

Page 2 of 4

PHOTOS:

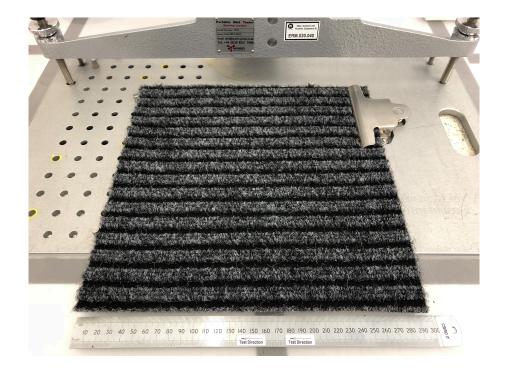

Top view

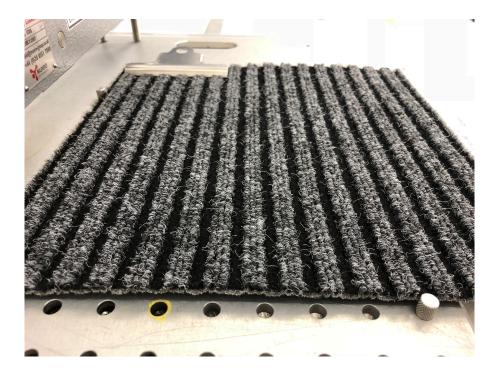



Gate 5, 2 Normanby Road Clayton VIC 3168, Australia Telephone: 61 3 9545 2777 Web: http://www.csiro.au

REPORT NO:8163AISSUE DATE:16 October 2018MANUFACTURER:ImportedPRODUCT DESC:Decord, PP carpet with Latex coating at back.

SLIP RESISTANCE CLASSIFICATION OF NEW PEDESTRIAN SURFACE MATERIALS

Page 3 of 4

WET PENDULUM TEST METHOD

	RIED OUT IN / 013 (Appendix /		CE WITH			Test Date:	15 October 2018	
RESULTS:	Location:	Slip Resistar	nce Labora	itory	Slider used: 96 Conditioned with grade P400 paper, dry and Imperial Lapping Film Grade 3MIC, wet			
Sample: Unfixed Cleaning: Dry el/static cloth Temperature: 21.4°C								
	Friction Tester: cted by: Khanh		I0 (S/N: 1	726, calibra	ated 06/09/	18)		
		Specimen 1	2	3	4	5		
Last 3 s	swings (BPN)	58 57 57	60 59 59	59 59 59	59 59 59	59 59 59		
Average	es	57	59	59	59	59		
					Mea	an SRV :	59	
					CL	ASS :	P5	



Gate 5, 2 Normanby Road Clayton VIC 3168, Australia Telephone: 61 3 9545 2777 Web: http://www.csiro.au

REPORT NO: ISSUE DATE: MANUFACTURER: PRODUCT DESC:

8163A 16 October 2018 Imported Decord, PP carpet with Latex coating at back. Page 4 of 4

Date and Place

16 October 2018,

Clayton, Vic

Name, Title and Digital Signature:

KHANH HO Technical Officer Tel: 61 3 95452777 Email: Khanh.Ho@csiro.au